

The predicted effect of climate change on indoor overheating of heritage apartments in two different Chinese climate zones

Lei, Muxi; van Hooff, Twan; Blocken, Bert; Pereira Roders, A.

DOI

[10.1177/1420326X221085861](https://doi.org/10.1177/1420326X221085861)

Publication date

2022

Document Version

Final published version

Published in

Indoor and Built Environment

Citation (APA)

Lei, M., van Hooff, T., Blocken, B., & Pereira Roders, A. (2022). The predicted effect of climate change on indoor overheating of heritage apartments in two different Chinese climate zones. *Indoor and Built Environment*, 31(7), 1986-2006. <https://doi.org/10.1177/1420326X221085861>

Important note

To cite this publication, please use the final published version (if applicable). Please check the document version above.

Copyright

Other than for strictly personal use, it is not permitted to download, forward or distribute the text or part of it, without the consent of the author(s) and/or copyright holder(s), unless the work is under an open content license such as Creative Commons.

Takedown policy

Please contact us and provide details if you believe this document breaches copyrights. We will remove access to the work immediately and investigate your claim.



The predicted effect of climate change on indoor overheating of heritage apartments in two different Chinese climate zones

Muxi Lei¹ , Twan van Hooff² , Bert Blocken³  and Ana Pereira Roders⁴

Abstract

Understanding the effects of climate change on building indoor thermal conditions is of importance for providing a comfortable thermal environment for occupants. Some multi-family dwellings have already been listed as heritage in China (hereinafter referred to as heritage apartments), limiting modifications to the building envelope. However, the effect of climate change on thermal comfort in heritage apartments with a compact interior (i.e. without a living room) built before the 1980s in different Chinese climate zones has seldom been studied. This study focuses on the current and future thermal comfort in two-bedroom heritage apartments in China. The study was conducted for two different Chinese climate zones, that is, a cold climate zone (Beijing), and a hot summer and cold winter climate zone (Shanghai) and both current climate scenarios (typical meteorological years) and future climate scenarios (2050) were used. The results indicate, among other things, increases of 58%–60% and 41%–44% in the predicted average number of overheating hours in 2050 compared to the current climate for the studied bedrooms on the first floor in dwellings in Beijing and Shanghai, respectively.

Keywords

Heritage apartments, Thermal comfort evaluation, Climate change effects, Apartment location, Window orientation

Introduction

In 2017, nearly 40% of global energy-related CO₂ emissions were attributed to buildings and construction,¹ and global CO₂ emissions caused by buildings have continued to increase by approximately 1% annually since 2010.² Moreover, the global mean surface temperature from 2046 to 2065 will be 1.0°C–2.0°C higher than in the period from

1986 to 2005 as estimated by the Intergovernmental Panel on Climate Change (IPCC).³ The resulting increase in outdoor air temperature in the future can impact building occupants' thermal comfort if active cooling systems are absent⁴ or increase energy consumption for cooling.^{5–7}

For China, very similar observations can be made. In 2016, buildings accounted for approximately 19.0% of China's total energy-related carbon emissions.⁸ The annual

¹Unit Building Physics and Services, Department of the Built Environment, Eindhoven University of Technology, Eindhoven, The Netherlands; Unit Architectural Urban Design and Engineering, Department of the Built Environment, Eindhoven University of Technology, Eindhoven, The Netherlands

²Unit Building Physics and Services, Department of the Built Environment, Eindhoven University of Technology, Eindhoven, The Netherlands

³Unit Building Physics and Services, Department of the Built Environment, Eindhoven University of Technology, Eindhoven, The Netherlands; Building Physics and Sustainable Design, Department of Civil Engineering, KU Leuven, Leuven, Belgium

⁴Department of Architectural Engineering & Technology, Faculty of Architecture and the Built Environment, Delft University of Technology, Delft, The Netherlands

Corresponding author:

Muxi Lei, Department of the Built Environment, Eindhoven University of Technology, P.O. Box 513, 5600 MB Eindhoven, The Netherlands.

Email: m.lei@tue.nl

mean near-surface air temperature in China in 2018 was about 1.2°C higher than in 1901⁹ and it will be 1.5°C–2.8°C higher in 2030 and 3.4°C–5.3°C higher in 2080 than the average of 1961 to 1990.¹⁰ Consequently, the predicted trend of increased ambient air temperatures may lead to an increase in the air temperature in indoor environments, and especially summer indoor overheating can become a concern.

Indoor thermal comfort is essential for residents. In addition to possible health issues,¹¹ thermal discomfort can lead to sleeping problems¹² and subsequently a loss of productivity during the day.¹³ Therefore, focussing on thermal comfort in residential buildings is of great importance.¹⁴

In China, dwellings built to meet the growing population demands in the absence of energy regulations are considered to be highly energy consuming and greenhouse gas emitting.¹⁵ The total residential building sector in China accounted for 10.3% of China's CO₂ emissions in 2012.¹⁶ The Chinese government has prioritized building energy efficiency since the early 1980s,¹⁷ leading to the development of building energy efficiency policies ever since.¹⁸ Moreover, the first residential building energy code was implemented in 1986 in China,¹⁹ and the work of insulating building walls started in China in the 1980s.²⁰ Therefore, it is necessary to focus on existing buildings' energy efficiency and thermal comfort in general, and more in particular on the energy efficiency and thermal comfort of dwellings built in the period in which energy regulations were still absent, that is, before the 1980s. In Chinese urban areas, around 9% of families live in residences built before the 1980s, which currently account for 6% of the total residential floor area.²¹ Due to climate change effects and the increased urban heat island effect due to increased levels of urbanization, the air temperatures in cities have increased in the last decades.^{22,23} This increase can lead to a decrease in thermal comfort levels in buildings and occupants might resort to active cooling systems to create comfortable indoor conditions. This would result in an increase in the building energy demand while there is a need to reduce building energy demand as much as possible.

The effect of climate change on building indoor thermal comfort – among other aspects – has been previously studied for different buildings and climate zones.^{4,24–27} Moreover, some studies specifically focused on these effects for Chinese climate zones. Chai et al.²⁸ studied future indoor thermal comfort in five different Chinese cities based on downscaled results from a general circulation model (GCM). They indicated that climate change could affect thermal comfort in different cities in a different way due to different future outdoor air temperatures. Liu et al.²⁹ studied the effect of climate change on indoor thermal comfort in a Hong Kong residential buildings, and reported that the number of comfortable hours for the baseline model would be decreased from 3502 in a typical meteorological year to 3225 in a representative concentration pathway (RCP) 8.5 in the 2090s. In a related study by Liu et al.,³⁰ the percentage

of thermal discomfort hours in the studied residential building during the cooling season would be increased from 21.9% in a typical meteorological year to 36.0% in RCP 4.5 and to 50.4% in RCP 8.5 in the 2090s. The effect of climate change on shipping container buildings in China was studied by Kristiansen et al.³¹ They indicated that for the compact case in the studied locations, climate change could improve indoor thermal comfort during the heating season, while possible discomfort by increased indoor temperatures could be counteracted by using an active cooling system. Zou et al.³² studied the effect of climate change on indoor thermal comfort in a classroom in Guangzhou. They concluded that for optimal solutions, decreases were found in the number of annual minimum winter thermal discomfort hours in RCP 4.5 (–24.4%) and RCP 8.5 (–41.1%) compared to in a typical meteorological year. The aforementioned studies are summarized in Table 1. However, none of the aforementioned studies focused on the effect of climate change on indoor thermal comfort in heritage apartments built before the 1980s with a compact building interior (i.e. without a living room) in different Chinese climate zones. Therefore, this study focuses on the effect of climate change on indoor thermal comfort in heritage apartments with a compact interior, built before the 1980s in two different Chinese climate zones, that is, Beijing in a cold climate zone and Shanghai in hot summer and cold winter climate zone.³³ The novelty of this paper, thus lies in the quantification of the (change in) overheating risk of the aforementioned apartments in two Chinese cities, when subjected to a possible future climate. The influence of apartment location (floor) and building orientation are included as secondary outcomes.

Methodology

Numerical simulations were performed using the simulation program EnergyPlus (version 9.1.0)^{34,35} based on current and future climate scenarios in Beijing and Shanghai. The development of EnergyPlus was funded by the Department of Energy (DOE) of the USA and it has been validated extensively in the past.^{36–39} Adaptive thermal comfort models^{40,41} were selected to evaluate occupants' thermal comfort conditions in bedrooms based on a generic apartment model.

Weather data

Two of the largest Chinese cities, that is, Beijing and Shanghai, were selected to represent climate conditions in a cold climate zone and a hot summer and cold winter climate zone in China, respectively.

Two types of weather files were studied: (1) typical meteorological years as current climate scenarios (hereinafter typical years) from the 'International Weather for Energy Calculations' (IWEC) dataset in the suburban area

Table 1. Non-exhaustive literature review on the effect of climate change on building indoor thermal comfort.

No.	Author (date)	Location	Building type	Future climate	Future year	Construction ^a (W/m ² K)	Heritage
1	Van Hooff et al. ⁴	The Netherlands	Residence	An expected future	2006 (a representative year)	Wall: 0.4 m ² K/W, 3.5 m ² K/W; roof: 0.8 m ² K/W; W, 4 m ² K/W; window: 1.65, 5.20	No
2	Barbosa et al. ²⁴	Lisbon	Residence	SRES A2	2050, 2080	Wall: 1.7; window: 2.4	No
3	Chai et al. ²⁸	Harbin, Beijing, Shanghai, Kunming, Hong Kong	Office	RCP 4.5	2021–2080	Wall: 0.46–2.70; roof: 0.38–0.89; window: 1.40–5.70	No
4	Ayikoe Tettey and Gustavsson ²⁵	Växjö	Residence	RCP 2.6, RCP 4.5, RCP 8.5	2090–2099	Wall: 0.311–0.346; attic floor: 0.092; window: 2.9	No
5	Liu et al. ²⁹	Hong Kong	Residence	RCP 4.5, RCP 8.5	2035s, 2065s, 2090s	Wall: 2.75; roof: 0.58; glazing: 5.75	No
6	Liu et al. ³⁰	Hong Kong	Residence	RCP 4.5, RCP 8.5	2035s, 2065s, 2090s	Wall: 2.75; roof: 0.58; glazing: 5.75	No
7	Muñoz González et al. ²⁶	Province of Seville	Church	SRES A2	2050	Wall: 0.63–0.87; roof attic: 1.78–4.27; window: 1.71–5.70	Yes
8	Jafarpur and Berardi ²⁷	Quebec City, Toronto, Vancouver	Office	RCP 8.5	2056–2075	Wall: 3.3–3.6 m ² K/W; roof: 5.5–6.3 m ² K/W; window: 2.7	No
9	Kristiansen et al. ³¹	Harbin, Lanzhou, Kunming, Shanghai, Guangzhou	Residence	SRES A2	2020, 2050	Wall: 0.10, 0.26; roof: 0.10, 0.26, window: 0.71, 2.80	No
10	Zou et al. ³²	Guangzhou	Education	RCP 4.5, RCP 8.5	2020s–2090s	Wall: 0.2–0.4 m (brick wall thickness), 0.00–0.12 m (thermal insulation thickness); window: 0.930–3.437	No

SRES = special report on emissions scenarios; RCP: representative concentration pathway.

^aIf no units are present U values are reported (in W/m²K). If R values are reported their unit (i.e. m²K/W) is added behind the numbers.

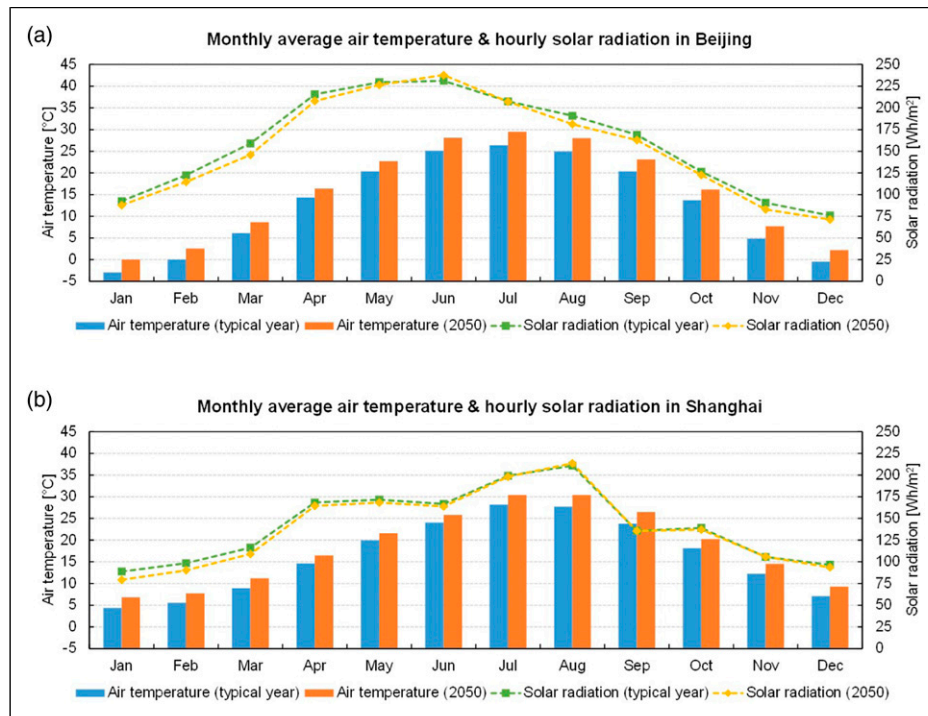


Figure 1. Monthly average air temperatures and hourly solar radiation in the typical year and 2050 in (a) Beijing and (b) Shanghai.^{42,43,45}

of Beijing from 1983 to 1999,⁴² and in the urban area of Shanghai from 1983 to 1995;⁴³ (2) predicted future climate scenarios in 2050 generated by CCWorldWeatherGen⁴⁴ based on the selected IWEC typical years in Beijing and Shanghai. Note that the urban heat island effect is thus already included in the weather files. CCWorldWeatherGen version 1.9, which was developed by the Sustainable Energy Research Group of the University of Southampton, was used.⁴⁵ It is based on GCM model HadCM3, SRES A2 scenario, and is capable of transforming the present baseline EnergyPlus Weather File (EPW) into different future EPWs.⁴⁵

The annual mean air temperature in Beijing is 12.8°C in a typical year and will increase to 15.5°C (+2.7°C) in 2050. Similarly, the annual mean air temperature in Shanghai is 16.3°C in a typical year and will increase to 18.5°C (+2.2°C) in 2050. For the annual mean solar radiation, however, small decreases are observed in 2050, that is, -3.2% in Beijing and -2.3% in Shanghai. The reduction can be caused by the increase in atmospheric water vapour and aerosol content, as indicated by Qian et al.⁴⁶

The monthly average air temperature and hourly solar radiation for both cities are depicted in Figure 1. The monthly average air temperature in each month is higher in 2050 than in the typical year in Beijing (Figure 1(a)) and Shanghai (Figure 1(b)). In both cities, the highest monthly average air temperatures are in July (and August in Shanghai in 2050), that is, 26.4°C in Beijing and 28.2°C in

Shanghai in the typical year and 29.5°C in Beijing and 30.4°C in Shanghai in 2050. The monthly average hourly solar radiation in each month is similar in the typical year and in 2050 in Beijing (Figure 1(a)) and Shanghai (Figure 1(b)). The largest monthly average hourly solar radiation in Beijing occurs in June with 231.2 Wh/m² in the typical year and 237.9 Wh/m² in 2050. For Shanghai, the largest monthly average hourly solar radiation occurs in August with 210.9 Wh/m² in the typical year and 213.6 Wh/m² in 2050.

Figure 2 shows the hourly air temperature and solar radiation during July with a clear increase in the air temperatures in 2050 compared to the typical year in Beijing (Figure 2(a)) and in Shanghai (Figure 2(b)). In July, there will be an increase of 61.3% and 205.0% in hours with an air temperature above 25°C and 30°C, respectively, from the typical year to 2050 in Beijing. In Shanghai, from the typical year to 2050, there will be an increase of 13.6% and 91.1% in hours with an air temperature above 25°C and 30°C, respectively. Increases in air temperatures from the typical year to 2050 can also be observed in June and August in both cities. The monthly average hourly solar radiation during July in the typical year and in 2050 is similar for both cities, that is, 207.5 Wh/m² in the typical year and 207.1 Wh/m² in 2050 in Beijing, and 199.3 Wh/m² in the typical year and 198.1 Wh/m² in 2050 in Shanghai.

The Sustainable Energy Research Group⁴⁵ indicated that if the input timespan of the current weather data is expanded

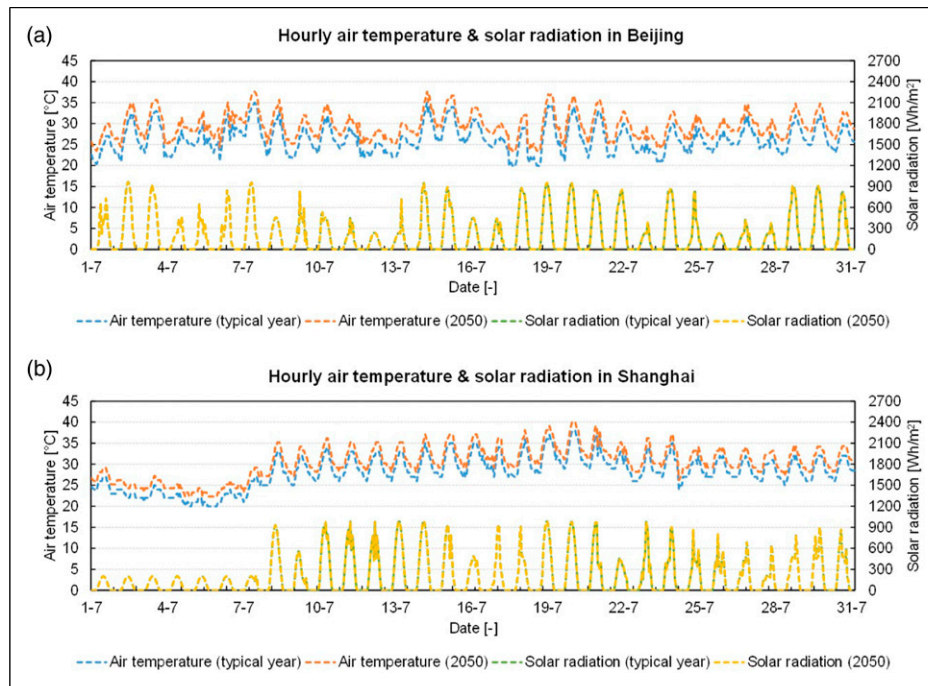


Figure 2. Hourly air temperatures and solar radiation during July in (a) Beijing and (b) Shanghai.^{42,43,45}

Table 2. Comparison of air temperatures in Beijing and Shanghai. The baseline years and the future years (2050, 2041–2070) for the different cities and sources are indicated in the section Weather Data.

City	Annual mean air temperature					
	IWEC based ^a			NCEI, NOAA and literature based ^b		
	The baseline year (°C)	2050 (°C)	Δ (°C)	The baseline year (°C)	2041–2070 (°C)	Δ (°C)
Beijing	12.8	15.5	2.7	12.1	15.0, 15.3	2.9, 3.2
Shanghai	16.3	18.5	2.2	16.2	18.6, 18.8	2.4, 2.6

^aAmerican Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE),⁴² American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE)⁴³ and Sustainable Energy Research Group.⁴⁵

^bThe National Centers for Environmental Information (NCEI) of National Oceanic and Atmospheric Administration (NOAA)^{47,48} and CNARCC Editorial Committee.¹⁰

beyond the required period of 1961–1990, as has been done in the present study due to the period available in the IWEC datasets, the generated 2050 climate may overestimate the climate change effect. However, the predicted increases in the average near-surface air temperatures in the period 2041 to 2070 (1961–1990 as a baseline) in Northern China (e.g. Beijing) and Eastern China (e.g. Shanghai),¹⁰ and the annual mean air temperatures of 1961–1990 (the aforementioned baseline period)^{47,48} are summarized in Table 2. It can be concluded that the effect of overestimation, if present, will be small (Table 2), and hence the obtained 2050 climate weather data files are considered to be

acceptable in general and for the purpose of this study in particular.

Heritage apartment model

Building geometry. In Beijing, two-bedroom apartments accommodated 40.5% of residents in 2017.⁴⁹ Moreover, the normal working class residents in Shanghai usually live in two-bedroom apartments of 80–100 square metres⁵⁰ and two-bedroom apartments with one bathroom seem to be the most typical Shanghai rental units.⁵¹ Therefore, two-bedroom apartments were selected

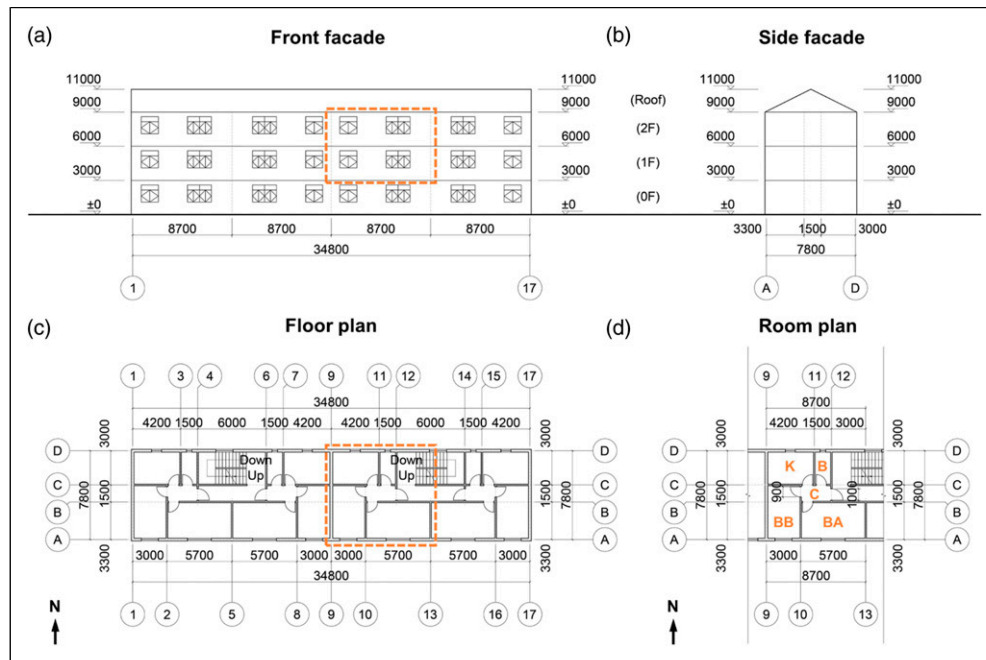


Figure 3. Studied generic apartment building (based on Xue and Lou,⁵⁷ Chen,⁵⁴ <https://sh.lianjia.com/>,⁶² <https://bj.lianjia.com/>⁶¹). (a) Front facade, (b) side facade, (c) floor plan and (d) room plan. The dashed boxes in (a) and (c) indicate the location of the studied apartments. In (d), BA = Bedroom A; BB = Bedroom B; K = Kitchen; B = Bathroom and C = Corridor. The arrows in (c) and (d) indicate the north direction (bedroom windows oriented towards the south). Dimensions in mm.

for the case study of multi-family dwellings due to their typical unit type and the relatively large share of residents they accommodate per square metre.

Some two-bedroom apartments have been listed as heritage. For example, in Beijing, the Baiwanzhuang neighbourhood has been listed as ‘Chinese Architectural Heritage of the 20th Century’ (second batch)⁵² and is a representative of the first generation of ‘Jiefang’ (neighbourhood) style residence in China.⁵³ The Baiwanzhuang neighbourhood was built in the 1950s and includes two-bedroom apartments.⁵⁴ In Shanghai, there are 75 modern apartment buildings that have been listed as heritage on five Shanghai historical building preservation lists, which include two-bedroom apartments.⁵⁵ In addition, the Shanghai Yongjia New Village (Yongjia Xin Cun) that was built in 1947⁵⁶ includes two-bedroom apartments,⁵⁷ and has been listed as ‘Shanghai Heritage Architecture’ (second batch)⁵⁸ and is a typical example of an apartment style ‘Lilong’ (neighbourhood) dwelling.⁵⁹

Once a building is listed as heritage, modifications on the building envelope might be constrained by preservation requirements,⁶⁰ while the building might be in use for several more decades and may thus pose long-term effects on occupants’ thermal comfort and building energy demand. Moreover, there might be more two-bedroom apartments built in the past that will become listed as

heritage in the future. Hence, considering (1) the long-term occupant thermal comfort effects posed by heritage apartments, (2) its existing diversity and (3) the future potential heritage status of two-bedroom apartments, this study focused on two-bedroom heritage apartments, selecting the aforementioned neighbourhoods as case studies: Baiwanzhuang neighbourhood in Beijing and Yongjia New Village in Shanghai.

Similarities in the building characteristics, that is, the floor number, bedroom dimensions, total floor area, interior layout (without living room) and slab-style geometry were identified in two publications^{54,57} and data from the online real estate platform Lianjia.com.^{61,62} Based on the identified data, a simplified generic two-bedroom apartment building was formulated which was assumed to be built in the 1940s–1950s, with heritage status, based on the aforementioned two heritage apartments and the similarities in their building characteristics (Figure 3). Note that only the first and second floor apartments were studied, while the ground floor was not considered to avoid ground effects on the heat balance (see Figure 3(a)). Moreover, there are some differences regarding the building characteristics, that is, a brick–concrete structure for Beijing⁶³ versus a brick–wood structure for Shanghai⁵⁶ and envelope surface colour (red for Beijing versus white for Shanghai^{53,62}). The formulated generic apartment was studied in the two selected climate

Table 3. Building construction details (R_c values were based on material properties from the Chartered Institution of Building Services Engineers (CIBSE)⁶⁵ and GB 50176-2016³³).

City	Component	Construction (from outside to inside)	d_{total} (mm)	R_c ($\text{m}^2\text{K}/\text{W}$)
Beijing	External wall	Plaster, brick (external), cement mortar (wall)	410	0.57
	Internal wall	Cement mortar (wall), brick (internal), cement mortar (wall)	160	0.21
	Internal floor/ceiling	Cement mortar (floor/ceiling), reinforced concrete, cement mortar (floor/ceiling)	180	0.13
	Ground floor	Rammed earth, concrete, cement mortar (floor/ceiling)	595	0.61
	Pitched roof	Clay tile, timber roof deck	35	0.17
	Door	Timber door	30	0.23
	Window	Single-pane glazing (U value = $5.20 \text{ W}/\text{m}^2\text{K}$; solar heat gain coefficient (g-value) = 0.70^{66})	—	—
Shanghai	External wall	Plaster, brick (external), cement mortar (wall)	280	0.39
	Internal wall	Cement mortar (wall), brick (internal), cement mortar (wall)	160	0.21
	Internal floor/ceiling	Timber deck, air cavity ($d = 150 \text{ mm}$, $R_{\text{cav}} = 0.19 \text{ m}^2\text{K}/\text{W}^{67}$), timber deck	180	0.43
	Ground floor	Rammed earth, concrete, cement mortar (floor/ceiling)	595	0.61
	Pitched roof	Clay tile, timber roof deck	35	0.17
	Door	Timber door	30	0.23
	Window	Single-pane glazing (U value = $5.20 \text{ W}/\text{m}^2\text{K}$; solar heat gain coefficient (g-value) = 0.70^{66})	—	—

Table 4. Occupancy schedule (bedroom occupancy was based on Hu et al.⁶⁹).

	Bedroom A		Bedroom B		Kitchen	
	Timespan	Activity	Timespan	Activity	Timespan	Activity
Monday to Friday	7:00–7:30 h	Breakfast	0:00–6:30 h	Sleeping	6:30–7:00 h	Cooking
	18:00–19:00 h	Dinner	22:30–24:00 h	Sleeping	17:00–18:00 h	Cooking
	19:00–22:30 h	Living activity				
Weekends	9:00–9:30 h	Breakfast	0:00–8:30 h	Sleeping	8:30–9:00 h	Cooking
	12:00–13:00 h	Lunch	13:00–15:00 h	Sleeping	11:00–12:00 h	Cooking
	19:00–20:00 h	Dinner	23:00–24:00 h	Sleeping	18:00–19:00 h	Cooking
	20:00–23:00 h	Living activity				

zones. The effect of urban surroundings with respect to the obstruction of solar radiation was not included in this study to keep the results as generic as possible.

Building construction and materials. A brick–concrete structure for the Beijing case^{53,63} and a brick–wood structure for the Shanghai case^{56,57,64} were used (see Table 3).

The values for solar reflectivity and thermal emissivity were set to 0.3 and 0.9, respectively, for all opaque materials, except for the plaster for the Shanghai case (white plaster), for which the solar reflectivity value (albedo) was increased to 0.9.⁶⁸

Internal heat gains. The occupancy schedule of a working couple was assumed with bedroom occupancy based on Hu et al.⁶⁹ (see Table 4), and only considering limited behaviour changes between weekdays and weekends.

Moreover, a possible option of room usage in China was adopted, that is, Bedroom A was used as a living room, while Bedroom B was only used for sleeping. Table 5 summarizes the used internal heat gains. No internal heat gains were assumed for the bathroom and corridor. The occupancy schedule of the apartments (Table 4) and the studied internal heat gains (Table 5) in the two selected cities were assumed to be the same for the sake of clarity.

The skin surface areas of an adult male and female were taken equal to 1.8 m^2 and 1.6 m^2 , respectively.⁷⁰ The heat gain due to lighting was present in Bedroom A during dinners and living activities and in the Kitchen during cooking for dinners. Heat gain from the electric equipment was present during the occupancy of Bedroom A, Bedroom B and the Kitchen. However, for Bedroom B, only 10% of the electric equipment load was applied.⁷¹ For the kitchen appliances, the heat gain from the gas equipment in the

Table 5. Internal heat gains.

Internal heat gain type	Heat gains	Source
People	Sleeping: 72 W/64 W (male/female) Eating and living activity: 126 W/112 W (male/female) Cooking: 167 W/149 W (male/female)	GB/T 18048-2008/ISO 8996: 2004 ⁷⁰ and GB/T 50785-2012 ⁴¹
Lighting	5 W/m ²	JGJ 26-2018 ⁷³
Electric equipment	3.8 W/m ²	JGJ 26-2018 ⁷³
Kitchen appliances	Gas equipment: 1000 W Refrigerator: 60 W	2021 ASHRAE Handbook ⁶⁶ Hasan et al. ⁷⁴

kitchen was only present during cooking, and the heat gain from the refrigerator was assumed to be constant throughout a day. The fractions of radiant heat for all heat sources were based on Rea⁷² and 2021 ASHRAE Handbook.⁶⁶

Further simulation settings. EnergyPlus version 9.1.0^{34,35} was used in the present study for the numerical simulations. The number of simulation time steps was set to 6 per hour. Although this study focused on the non-heating periods, the space heating systems (ideal air systems) were included for the heating periods. Heating is available from 15th November to 15th March of the next year for Beijing,⁷⁵ whereas heating for Shanghai is available from 1st December to 28th February of the next year,⁷⁶ irrespective of the studied climate scenario. Therefore, the non-heating period in Beijing runs from 16th March until 14th November (5856 h), and in Shanghai from 1st March until 30th November (6600 h). The number of overheating hours and degree hours is only evaluated during the non-heating periods. During the heating period, the space heating is provided for all rooms during the entire day for Beijing,⁷³ while it is only provided when the occupants are present in Bedroom A (the living room) for Shanghai.^{77,78} The walls between the studied apartments and the neighbourhood apartments were assumed to be adiabatic. TARP and DOE-2 were used for the interior and exterior surface convections, respectively.^{79–81} Natural ventilation with fresh air supply through openings in the building façade was present, which was assumed to be relatively constant in practice, and therefore in the simulations, constant average ventilation rates were imposed with 0.6 h⁻¹ for Beijing and 1.0 h⁻¹ for Shanghai for the bedrooms.^{76,82} Moreover, a mechanical ventilation rate of 450 m³/h was provided for the kitchen during cooking only.⁸³ The infiltration rate was set to 0.645 h⁻¹ for all of the rooms and the roof attic, which was an average of values found in two publications for Beijing^{84,85} and it was assumed the same for Shanghai. Ground reflectivity values were set to 0.2 for all 12 months. Monthly average ground temperatures at 0.5 m depth from the IWEC weather files for Beijing and Shanghai were used.^{42,50}

Indoor thermal comfort evaluation

Overheating hours. The indoor thermal conditions in the studied apartments were evaluated based on the Chinese standard, GB/T 50785-2012,⁴¹ adaptive thermal comfort models for free running civil buildings in the Chinese cold climate zone (e.g. Beijing) and the Chinese hot summer and cold winter climate zone (e.g. Shanghai).

The selected thermal comfort models use the running mean outdoor temperature (T_{rm}), which was calculated using equation (1)⁴¹

$$T_{rm} = (1 - \alpha)(T_{od-1} + \alpha T_{od-2} + \alpha^2 T_{od-3} + \alpha^3 T_{od-4} + \alpha^4 T_{od-5} + \alpha^5 T_{od-6} + \alpha^6 T_{od-7}) \quad (1)$$

with T_{rm} = running mean outdoor temperature (°C); $\alpha = 0.8$ and T_{od-n} = daily average outdoor temperature of n days ago (°C).

Category II of the Chinese standard GB/T 50785-2012⁴¹ corresponding to 75%–90% acceptability⁴⁰ was used to determine the occupants' thermal comfort upper threshold, that is, the upper limit (T_{upper}) of the indoor operative temperature (T_o).⁶⁶ In the Chinese cold climate zone (e.g. Beijing), the upper threshold of Category II was calculated using equation (2)⁴¹

$$T_{upper} = 0.73 T_{rm} + 15.28 \quad (2)$$

with T_{upper} = upper limit of indoor operative temperature (°C) ($18^\circ\text{C} \leq T_{upper} \leq 30^\circ\text{C}$) and T_{rm} = running mean outdoor temperature (°C).

In the Chinese hot summer and cold winter climate zone (e.g. Shanghai), the upper threshold of Category II was calculated using equation (3)⁴¹

$$T_{upper} = 0.73 T_{rm} + 12.72 \quad (3)$$

where T_{upper} = upper limit of indoor operative temperature (°C) ($18^\circ\text{C} \leq T_{upper} \leq 30^\circ\text{C}$) and T_{rm} = running mean outdoor temperature (°C).

In the studied apartments, an overheating hour was recorded when the indoor operative temperature T_o is higher than the upper limit T_{upper} .

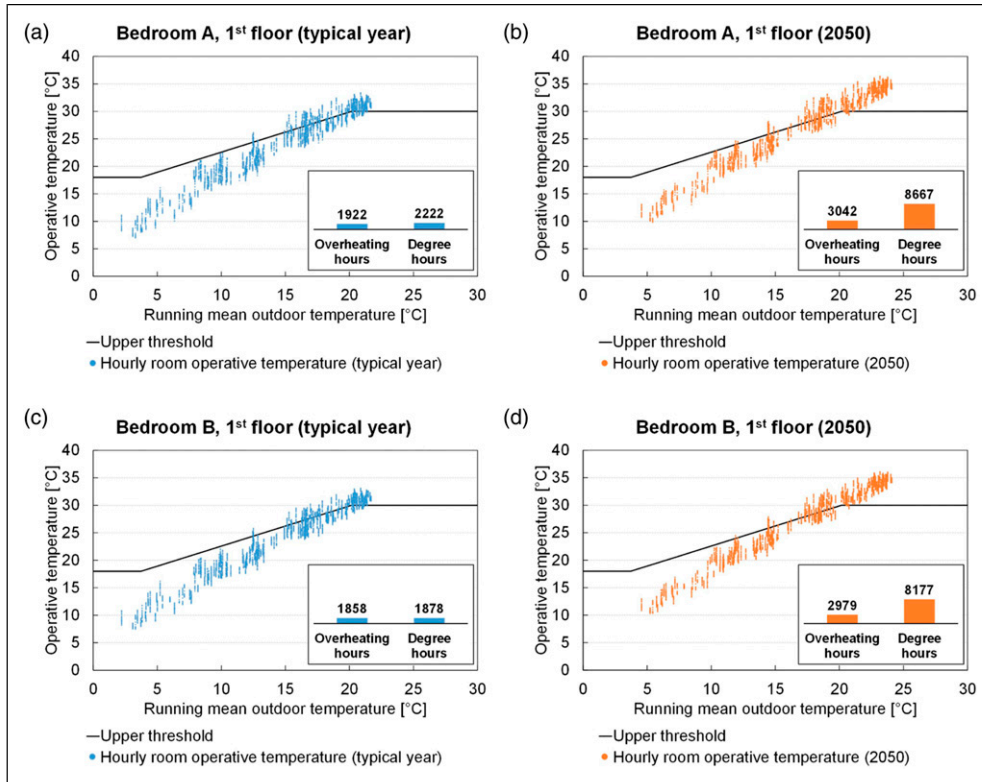


Figure 4. Number of overheating hours and degree hours on the first floor in Beijing in Bedroom A in (a) the typical year and in (b) 2050, and in Bedroom B in (c) the typical year and in (d) 2050. Windows of the bedrooms are oriented towards the south. In each graph, the dots represent hourly indoor operative temperatures during the non-heating period and the black solid line represents the upper limit of the thermal comfort threshold.⁴¹ The number of overheating hours and degree hours is shown in the bar chart in each subgraph.

Degree hours. The number of degree hours was selected as the other thermal comfort indicator for an indication of the degree of overheating based on the operative temperature (T_o) and the upper limit (T_{upper}). Degree hours (dhr) was calculated by equation (4). The degree hours are only included, when $T_o > T_{upper}$

$$\text{dhr} = \text{hr}(T_o - T_{upper}) \quad (4)$$

where dhr = degree hours ($^{\circ}\text{Ch}$); T_o = indoor operative temperature ($^{\circ}\text{C}$) and T_{upper} = upper limit of the indoor operative temperature ($^{\circ}\text{C}$).

Results

The simulation results for Beijing and Shanghai are presented below in two sections, followed by a discussion on the results and a comparison with results from the literature.

Beijing

Effect of climate change on indoor overheating. This section presents the effect of climate change on indoor

overheating by comparing the number of overheating hours and degree hours in Bedroom A and Bedroom B in the typical year and 2050 in Beijing based on bedroom windows oriented towards the south. Compared to the typical year, an increase in the number of overheating hours was illustrated by the model from 1922 to 3042 (+58%) and an increase in the number of degree hours was also shown from 2222 to 8667 (+290%) in 2050 in Bedroom A on the first floor (Figure 4(a) and (b)). The number of overheating hours was increased from 1858 to 2979 (+60%) and the number of degree hours was increased from 1878 to 8177 (+335%) in 2050 in bedroom B on the first floor (Figure 4(c) and (d)).

The increase in the number of overheating hours and degree hours from the typical year to 2050 can also be observed in both Bedroom A and Bedroom B on the second floor (detailed numbers are not presented here for the sake of brevity). The reason for the increase in 2050 is the elevated air temperature in each month in 2050 compared to the typical year.

Effect of apartment location on indoor overheating. In this section, the number of overheating hours and degree

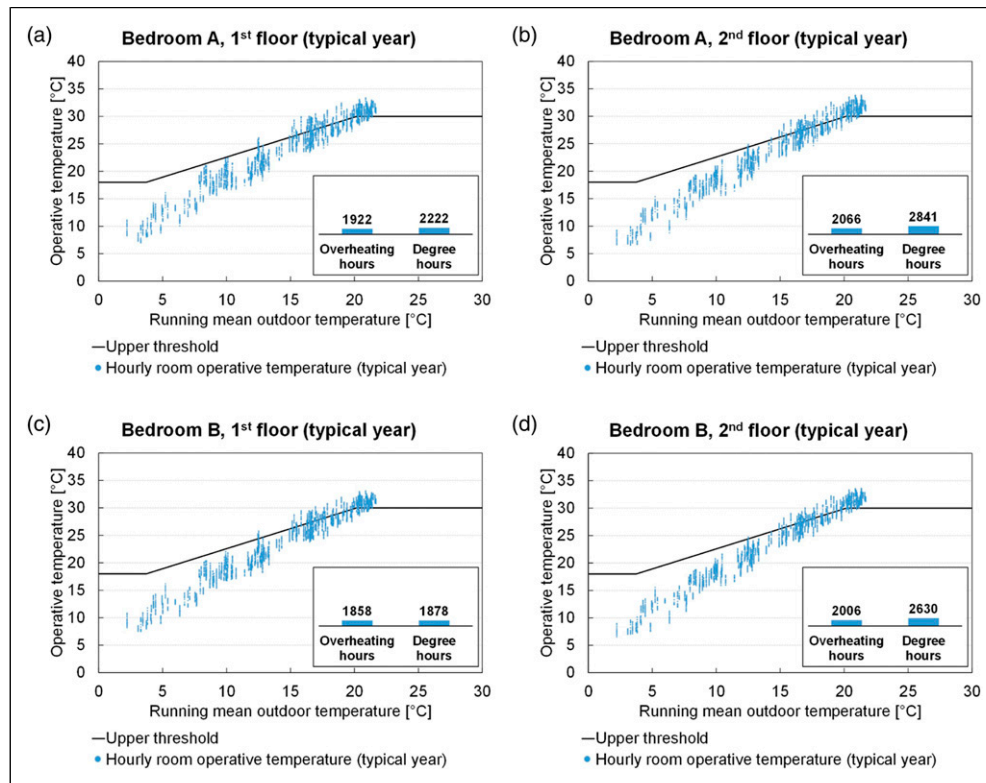


Figure 5. Number of overheating hours and degree hours in Bedroom A on (a) the first floor and on (b) the second floor, and in Bedroom B on (c) the first floor and on (d) the second floor in the typical year in Beijing. Windows of the bedrooms are oriented towards the south. In each graph, the dots represent hourly indoor operative temperatures during the non-heating period and the black solid line represents the thermal comfort upper threshold.⁴¹ The number of overheating hours and degree hours is shown in the bar chart in each subgraph.

hours in Bedroom A and in Bedroom B on the first and on the second floor were compared to study the effect of apartment location on indoor overheating, and the analysis, as in the previous section, was based on an orientation in which the bedroom windows are oriented towards the south. Figure 5 shows increases in the number of overheating hours in Bedroom A from 1922 to 2066 (+7%) and increases in the number of degree hours from 2222 to 2841 (+28%) when the bedroom is located on the second floor in the typical year (Figure 5(a) and (b)). Similarly, in Bedroom B, increases in the number of overheating hours from 1858 to 2006 (+8%) and the number of degree hours from 1878 to 2630 (+40%) were found when the bedroom is located on the second floor in the typical year (Figure 5(c) and (d)).

Similar increasing trends can also be observed in the bedrooms in 2050; however, the detailed numbers are not presented here for the sake of brevity. The increased number of overheating hours and degree hours is caused by the higher air temperature in the attic due to solar radiation on the roof surface resulting in an additional heat gain in the apartment on the second floor, which is directly located underneath the attic.

Effect of building orientation on indoor overheating. The results presented in the previous sections only consider an orientation with the bedroom windows oriented towards the south. Therefore, this section presents an analysis of the effect of eight different orientations (bedroom windows orientated towards the south (S), southwest (SW), west (W), northwest (NW), north (N), northeast (NE), east (E) and southeast (SE)) on the number of overheating hours and degree hours as indicated in Figure 6. The largest and smallest number of overheating hours and degree hours were compared to the average over the eight orientations and the percentage differences are reported in the text below.

In the typical year, in Bedroom A on the first floor, the largest number of overheating hours (2318, +33%) and degree hours (3462, +50%) occurs when the bedroom window is oriented towards SW, while the smallest number of overheating hours (689, -60%) and degree hours (358, -84%) occurs, as to be expected, when it is oriented towards N (Figure 6(a) and (b)). In Bedroom B on the first floor, the largest number of overheating hours (2236, +25%) occurs when the bedroom window is oriented towards SW, and the largest number of degree hours (3305, +45%) occurs when the bedroom window is oriented towards W. The

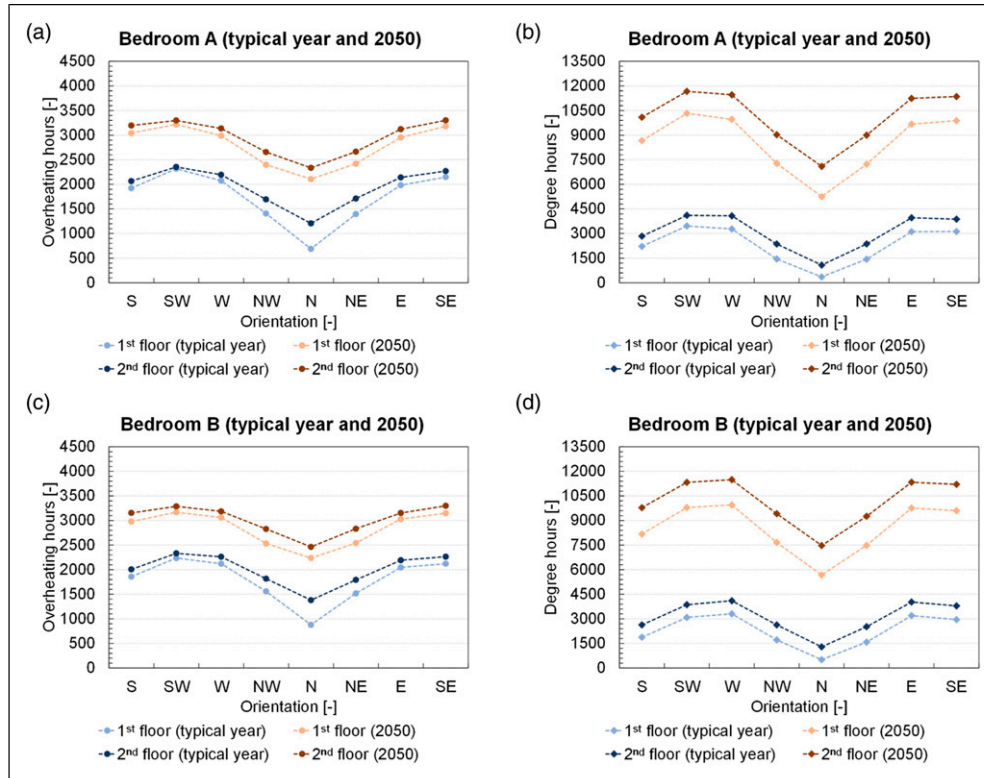


Figure 6. Numbers of (a) overheating hours and (b) degree hours in Bedroom A, and the numbers of (c) overheating hours and (d) degree hours in Bedroom B in the typical year and 2050 with eight different orientations of an apartment in Beijing.

smallest number of overheating hours (879, -51%) and degree hours (511, -78%) occurs again when it is oriented towards N (Figure 6(c) and (d)). Bedroom A and Bedroom B on the second floor show similar results with respect to the largest and smallest number of overheating hours and degree hours (Figure 6).

In 2050, the orientations with the largest and smallest number of overheating hours and degree hours in Bedroom A and Bedroom B on the first floor are the same as in the typical year (Figure 6). Bedroom A and Bedroom B on the second floor show the same orientations with the largest and smallest number of overheating hours and degree hours as on the first floor in 2050, except for the largest number of overheating hours, which occurs when the bedroom windows are oriented towards SE (Figure 6).

In addition, for each orientation, and on average, a larger number of overheating hours and degree hours in a bedroom is present in 2050 than in the typical year, and the number of hours is larger on the second floor than on the first floor. For example, in Bedroom A on the first floor, the average number of overheating hours will be increased from 1742 in the typical year to 2788 ($+60\%$) in 2050, and the average number of degree hours will be increased from 2308 in the typical year to 8536 ($+270\%$) in 2050. For Bedroom A in the

typical year, the average number of overheating hours will be increased from 1742 on the first floor to 1955 ($+12\%$) on the second floor, and the average number of degree hours will be increased from 2308 on the first floor to 3086 ($+34\%$) on the second floor.

Shanghai

Effect of climate change on indoor overheating. Figure 7 shows the number of overheating hours and degree hours in Bedroom A and Bedroom B with the bedroom windows oriented towards the south in the typical year and in 2050 in Shanghai. An increase in the number of overheating hours and degree hours in 2050 compared to in the typical year was illustrated in Bedroom A and in Bedroom B, irrespective of the studied floor level.

For Bedroom A on the first floor, the number of overheating hours was illustrated to have increased from 2056 in the typical year to 3034 ($+48\%$) in 2050, and an increase in the number of degree hours from 3613 in the typical year to 7894 ($+118\%$) in 2050 was also shown by the model (Figure 7(a) and (b)). For Bedroom B on the first floor, an increase in the number of overheating hours was illustrated by the model, from 2131 in the typical year to 3231 ($+52\%$) in 2050, and the number of degree hours will be increased

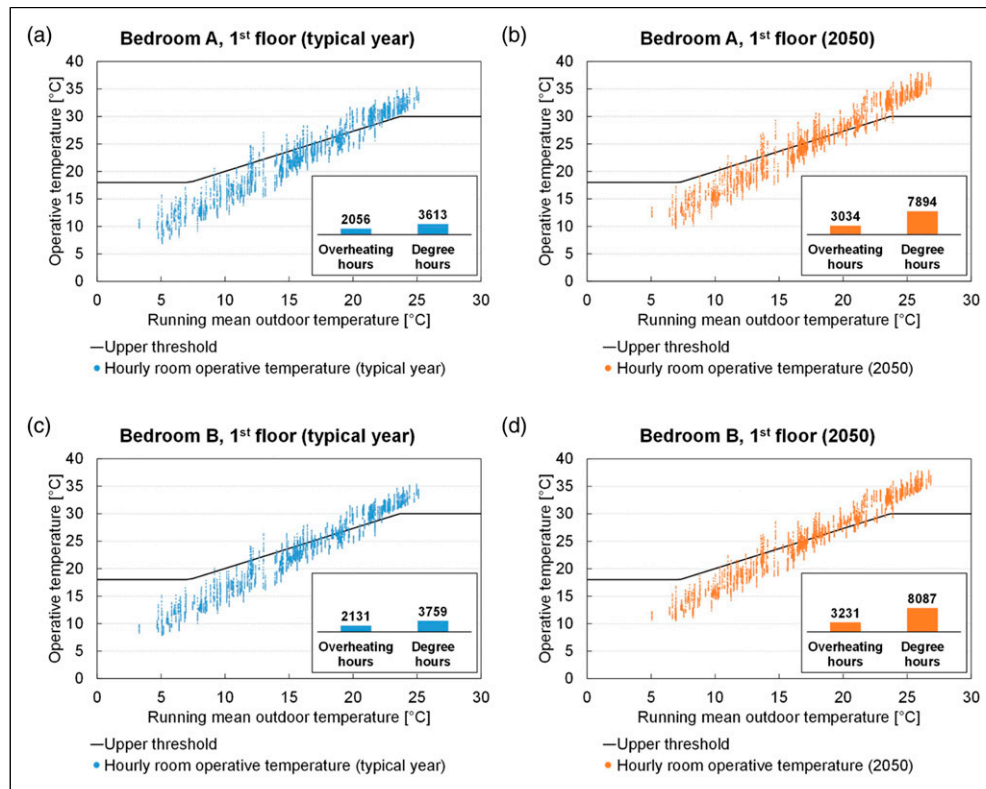


Figure 7. Number of overheating hours and degree hours on the first floor in Shanghai in Bedroom A in (a) the typical year and in (b) 2050, and in Bedroom B in (c) the typical year and in (d) 2050. Windows of the bedrooms are oriented towards the south. In each graph, the dots represent hourly indoor operative temperatures during the non-heating period and the black solid line represents the upper limit of the thermal comfort threshold.⁴¹ The number of overheating hours and degree hours is shown in the bar chart in each subgraph.

from 3759 in the typical year to 8087 (+115%) in 2050 (Figure 7(c) and (d)).

A larger number of overheating hours and degree hours is predicted in 2050 in comparison to the typical year is present in Bedroom A and Bedroom B on the second floor as well (detailed numbers are not presented here for the sake of brevity). The increase in 2050 can be explained by the higher ambient air temperatures in 2050, as was the case for Beijing.

Effect of apartment location on indoor overheating. This section presents a comparison of the predicted results for Bedrooms A and B on the second floor with those for the bedrooms on the first floor. In all cases, the bedroom windows are oriented towards the south. For Bedroom A in the typical year, the number of overheating hours was predicted to have increased from 2056 on the first floor compared to 2248 (+9%) on the second floor. The number of degree hours was predicted to have increased from 3613 on the first floor compared to 4873 (+35%) on the second floor (Figure 8(a) and (b)). For Bedroom B in the typical year, the number of overheating hours was predicted to have

increased from 2131 on the first floor compared to 2318 (+9%) on the second floor. The number of degree hours was predicted to have increased from 3759 on the first floor compared to 5049 (+34%) on the second floor (Figure 8(c) and (d)).

Similar increasing trends are illustrated by the model for 2050. However, the detailed numbers are not presented here for the sake of brevity. Again, the additional heat gain in the apartment on the second floor can be explained by the increased air temperature caused by heat gain in the adjacent attic due to solar radiation on the roof.

Effect of building orientation on indoor overheating. The effect of eight different orientations on the number of overheating hours and degree hours is presented in Figure 9. The largest and smallest number of overheating hours and degree hours and their percentage differences from the average over the eight orientations are reported in the text below.

In the typical year, in Bedroom A on the first floor, the largest number of overheating hours (2221, +8%) occurs when the bedroom window is oriented towards SW, while

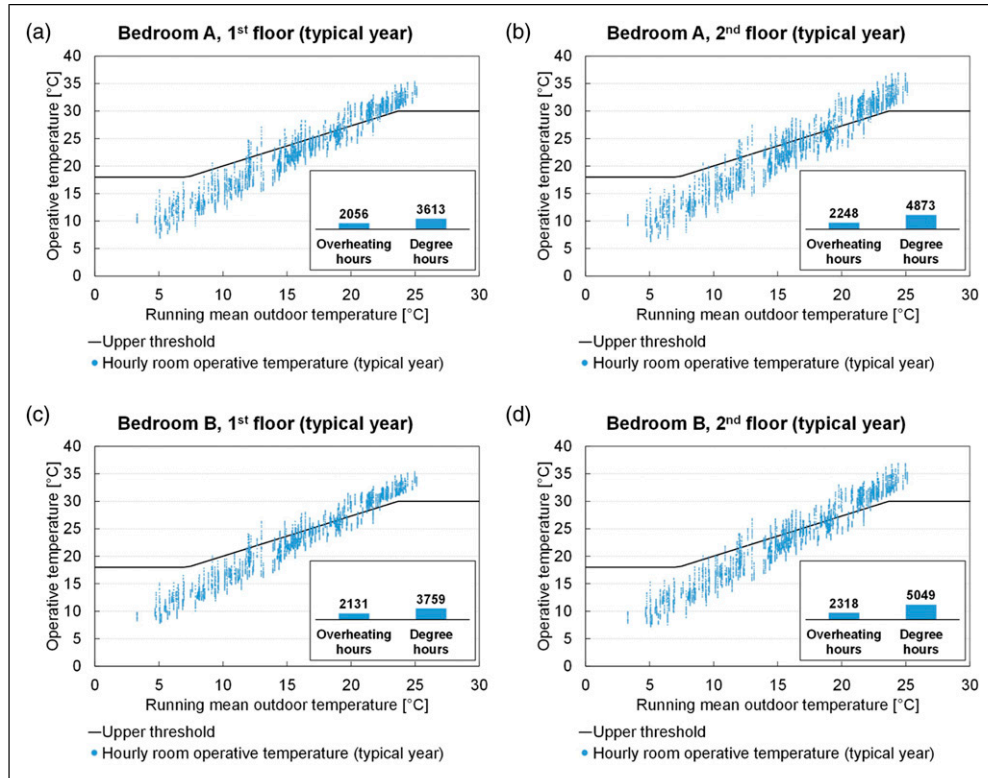


Figure 8. Number of overheating hours and degree hours predicted for Bedroom A on (a) the first floor and on (b) the second floor, and for Bedroom B on (c) the first floor and on (d) the second floor in the typical year in Shanghai. Windows of the bedrooms are oriented towards the south. In each graph, the dots represent hourly indoor operative temperatures during the non-heating period and the black solid line represents the thermal comfort upper threshold.⁴¹ The number of overheating hours and degree hours is shown in the bar chart in each subgraph.

the largest number of degree hours (5350, +25%) occurs when the bedroom window is oriented towards W. As expected, the smallest number of overheating hours (1700, -17%) and degree hours (2628, -39%) occurs when it is oriented towards N (Figure 9(a) and (b)). In Bedroom B on the first floor, the largest number of overheating hours (2340, +7%) occurs when the bedroom window is oriented towards SE, while the largest number of degree hours (5660, +24%) occurs when the bedroom window is oriented towards W. The smallest number of overheating hours (1847, -16%) and degree hours (2973, -35%) again occurs when it is oriented towards N (Figure 9(c) and (d)). Bedroom A and Bedroom B on the second floor show similar results with respect to the largest and smallest number of overheating hours and degree hours as on the first floor, except for the largest number of overheating hours for Bedroom A on the second floor, which occurs when the bedroom window is oriented towards SE (Figure 9).

In 2050, the largest number of overheating hours and degree hours occurs in Bedroom A and Bedroom B, when the bedroom windows are oriented towards SW and W, respectively, while the smallest number of overheating

hours and degree hours occurs when they are oriented towards N, irrespective of the floor at which the apartment is located (Figure 9).

Results in Shanghai show similar increasing trends as the results in Beijing showing the larger numbers of overheating hours and degree hours for each orientation and on average in bedrooms in 2050 and on the second floor.

Discussion of results

Climate change

The numbers of overheating hours and degree hours for each studied orientation and on average over the eight orientations are significantly larger in 2050 than in the typical year in a bedroom in Beijing and in Shanghai. Since the monthly average hourly solar radiation is similar in the typical year and in 2050, the predicted increases in air temperature for each month in 2050 compared to the typical year in Beijing and Shanghai (see the Weather Data section) are the main reason for the increasing number of overheating hours and degree hours in 2050.

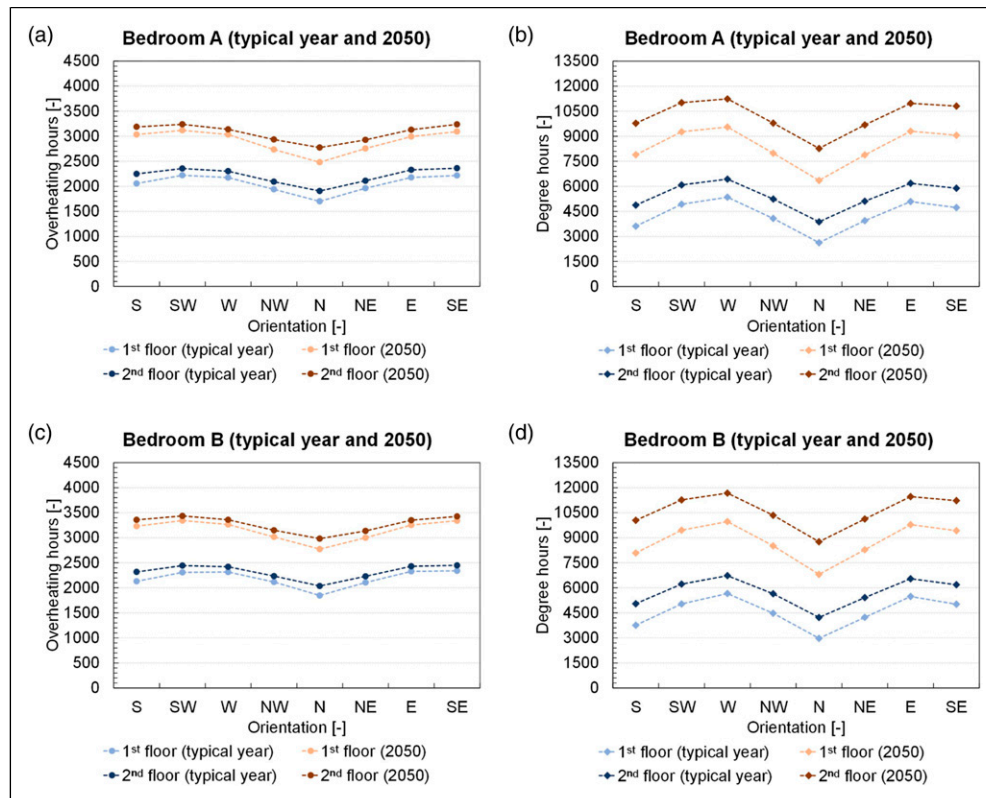


Figure 9. Numbers of (a) overheating hours and (b) degree hours in Bedroom A, and the numbers of (c) overheating hours and (d) degree hours in Bedroom B, predicted in the typical year and in 2050 for the eight different orientations in Shanghai.

Apartment location

The results indicate that the numbers of overheating hours and degree hours for each studied orientation and on average over the eight orientations in a bedroom on the second floor are larger than on the first floor, irrespective of the studied climate scenario and climate zone. This difference can be caused by the heat transfer from the attic to the room below the attic. Solar radiation on the roof surface can lead to higher air temperatures in the attic, and due to the very limited thermal resistance of the ceiling between the attic and the apartment, this can result in an increased air temperature in the apartment on the second floor.

Building orientation

For all the studied bedrooms, irrespective of climate zone and climate scenario, the largest numbers of overheating hours occur when the bedroom windows are oriented towards SW or SE. The similar solar elevation angle resulting in the comparable solar heat gain⁸⁶ could be a reason that these two orientations result in the largest number of overheating hours. The largest numbers of degree hours, however, occur in the cases in which the windows of studied

bedrooms are oriented towards the western side (SW or W). This can be attributed to higher air temperatures in the afternoon, in addition to the heat gain by solar radiation through the window. The smallest numbers of overheating hours and degree hours occur when the bedroom windows are oriented towards N, as to be expected, since this is the orientation with the lowest solar heat gain through the windows.

Comparison of overheating results

Whereas the heating systems were active in the previous analyses, the heating systems are turned off if the overheating results are reported for a full year to allow a fair comparison with results identified from literature (with similar thermal properties of the building envelope). The percentages as shown in Figure 10 were determined from the number of occupied hours and the number of overheating hours during the occupied hours, as summarized in Table 6. The results were considered for the bedrooms on the first floor with bedroom windows orientated towards the south in the typical years (results for the bedrooms on the second floor are not presented here for the sake of brevity).

In Beijing, the numbers of overheating hours in a full year from the present study, that is, 1922 and 1858 predicted

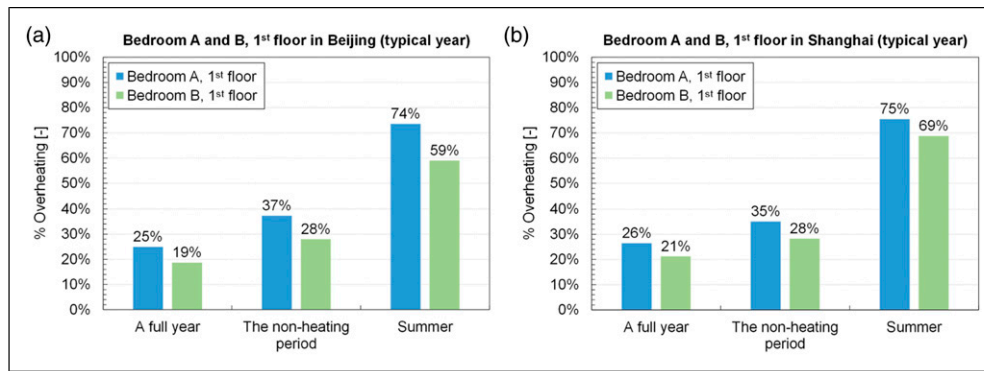


Figure 10. Percentages of overheating hours during occupied hours in Bedroom A and Bedroom B on the first floor with bedroom windows orientated toward the south in the typical year in (a) Beijing and (b) Shanghai. Percentages are based on values from Table 6.

Table 6. Numbers of occupied hours and overheating hours during occupied hours for Bedroom A and Bedroom B on the first floor with bedroom windows orientated toward the south in the typical year in Beijing and Shanghai.

	Beijing (cold climate)		Shanghai (hot summer and cold winter climate)	
	Bedroom A, first floor	Bedroom B, first floor	Bedroom A, first floor	Bedroom B, first floor
The number of occupied hours in a full year	1877	3284	1877	3284
The number of occupied hours in the non-heating period	1255	2197	1414	2473
The number of occupied hours in summer ^a	473	827	473	827
The number of overheating hours during the occupied hours in a full year ^b	468	614	496	698
The number of overheating hours during the occupied hours in the non-heating period	468	614	496	698
The number of overheating hours during the occupied hours in summer ^a	348	488	357	569

^aSummer in this table is defined as 1st June to 31st August in both cities.

^bHeating systems are turned off for the number of overheating hours during occupied hours in a full year.

for Bedroom A and Bedroom B, respectively, are smaller than the 2600–3300 h from the simulation study of Zou and Du⁸⁷ (Figure 11(a)). This difference can mainly be explained by the different air flow rate used, that is, 1.25 h⁻¹ air changes per hour (ACH) in the present study and 0.1–0.7 h⁻¹ ACH in the study of Zou and Du.⁸⁷ When the simulation of the present study was conducted with ACH values (ACH = 0.1 and 0.7 h⁻¹) similar to those in Zou and Du,⁸⁷ the number of overheating hours in the present building would be between 2424 and 3537 with ACH = 0.7 and 0.1 h⁻¹, respectively, which is in very good agreement with the number of overheating hours reported in Zou and Du.⁸⁷ In addition, the percentage of overheating during occupied hours in summer predicted by the present study, that is, 74% (see Figure 10(a)) is very similar to 72.7% from the survey reported by Gen and Du⁸⁸ (Figure 11(a)).

In Shanghai, the percentages of overheating during occupied hours in a full year predicted by the present study, that is, 26% (Bedroom A) and 21% (Bedroom B) (see Figure 10(b)) are very comparable to the interquartile range of 20%–30% from the simulations by Fosas et al.⁸⁹ (Figure 11(b)). Although the thermal transmittance of the external wall in Fosas et al.⁸⁹ was smaller, an additional simulation showed that this difference does not have a large effect on the percentage of overheating and thus still shows a good agreement. The results are not included here for the sake of brevity.

Limitations and future work

Apart from the presented results and findings, there are several topics that could be studied in the future.

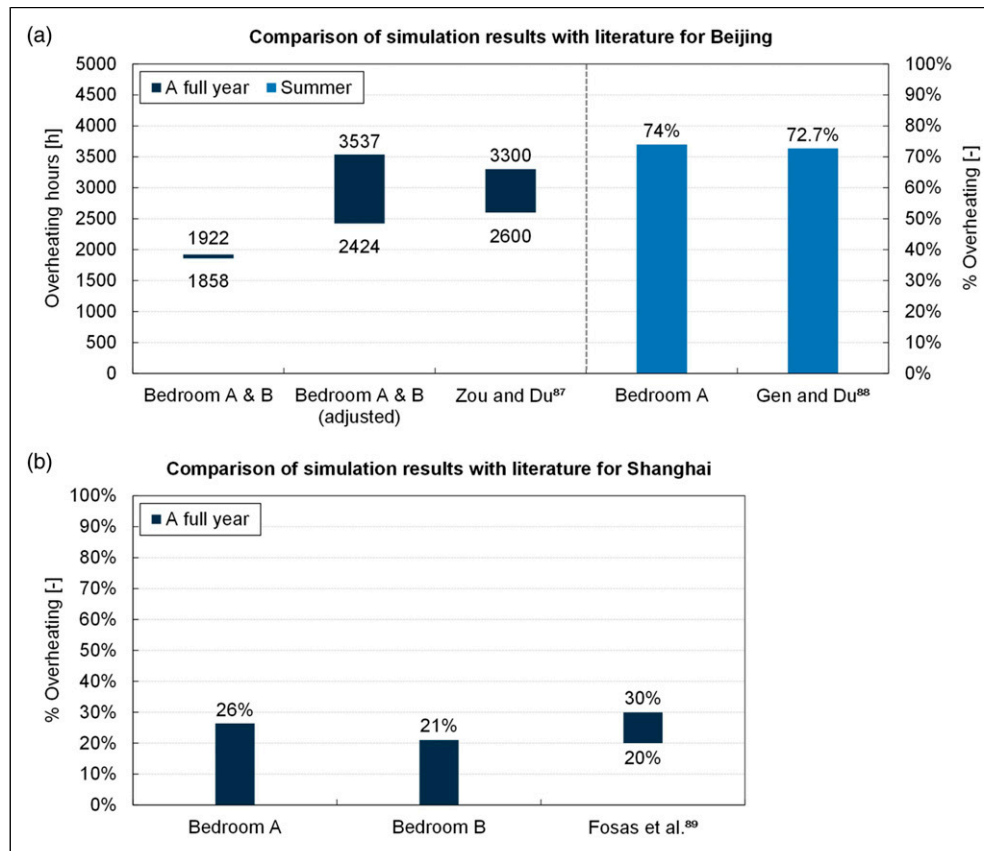


Figure 11. Comparison of the results from the present study with results from the literature for similar cases. (a) Beijing and (b) Shanghai. In (a), the values of 2424 and 3537 are from the adjusted ventilation rates, that is, air changes per hour = 0.7 and 0.1 h⁻¹, respectively.

1. Only two Chinese climate zones and one building geometry (slab geometry) were considered in this study. Future work could study other Chinese climate zones, and study other building geometries, for example, L-shape geometry and courtyard.
2. This study was based on one specific emission scenario and one future timespan, while additional emission scenarios (including RCPs (representative concentration pathways) from the IPCC (Intergovernmental Panel on Climate Change) Fifth Assessment Report³) and future timespans could be considered to assess the uncertainty in the predictions with respect to the effect of climate change on indoor thermal comfort and energy demand. Ongoing work focuses on an analysis of different climate change scenarios and their effect on future building thermal comfort and energy demand.
3. Future work could focus on other age groups, such as an older population with likely different thermal comfort sensations. Moreover, other thermal comfort models, for example, aPMV which was also included in the Chinese standard GB/T 50785-2012,⁴¹ can be

considered in future studies. In addition, other occupancy schedules can be used in future studies to include a wider variation of building usage.

4. Based on the assessment of indoor thermal comfort in the current and future climates, climate change adaptation measures are currently studied to increase indoor thermal comfort and simultaneously reduce building energy demand in heritage apartments in different climate zones in China. These measures include, but are not limited to, solar shading and passive cooling.

Conclusions and implications

The indoor thermal comfort in apartments with a compact interior (without a living room) built before the 1980s was studied by numerical simulations to understand the effects of climate change (typical meteorological years and 2050) on indoor overheating, which has, according to the best knowledge of the authors, not been done before. In addition, the effect of apartment location (first floor and second floor) and eight different orientations on indoor overheating are

presented. Heritage apartments in Beijing and Shanghai were selected as case studies, using the number of overheating hours and degree hours as the performance indicators of occupant thermal comfort.

The following detailed conclusions are made:

1. In 2050, considerably increase in the numbers of overheating hours and degree hours for each studied orientation and on average for all the studied bedrooms in Beijing and Shanghai were predicted by the model compared to the typical years, as a consequence of the predicted climate change.
2. Compared to the typical years, the average numbers of overheating hours are predicted to be at least 50% and around 40% higher in 2050 for the studied bedrooms in Beijing and Shanghai, respectively. Moreover, compared to the typical years, the average number of degree hours are predicted to be more than triple and nearly double in 2050 for the studied bedrooms in Beijing and Shanghai, respectively.
3. The number of overheating hours and degree hours for each studied orientation and their average values are larger for a bedroom on the second floor than on the first floor, irrespective of the studied climate scenario and climate zone. This is due to the influence of heat gains from the roof/attic, that is, due to the elevated air temperatures in the attic caused by the solar radiation on the roof surface and the minimal thermal resistance of the ceiling between the apartment and the attic.
4. For a studied bedroom, irrespective of climate zone and climate scenario, the largest number of overheating hours occurs when its bedroom window is oriented towards either SW or SE, due to the similar solar elevation angle with comparable solar heat gain from two orientations. The largest number of degree hours, however, occurs when the window of the bedroom is oriented towards the west (SW or W), which could be attributed to the simultaneous occurrence of the higher ambient air temperature in the afternoon and the solar radiation heat gain. As to be expected, the smallest number of overheating hours and degree hours occurs when the bedroom window is oriented towards N, due to the lowest solar heat gain through the window.

The study can be used as a starting point to determine proper renovation strategies for heritage apartments. The study also shows that the possible increase in the number of overheating hours is considerable and should be a point of consideration alongside the other more common considerations regarding climate change mitigation measures, that is, increased insulation levels and less infiltration to reduce energy demand and CO₂ emissions.

Acknowledgements

The financial support from the China Scholarship Council is acknowledged.

Authors' contribution

Muxi Lei and Twan van Hooff contributed 50% and 30%, respectively, and Bert Blocken and Ana Pereira Roders each contributed 10% in the preparation of this manuscript.

Declaration of conflicting interests

The author(s) declared no potential conflicts of interest with respect to the research, authorship, and/or publication of this article.

Funding

The author(s) disclosed receipt of the following financial support for the research, authorship, and/or publication of this article: This study was financially supported by the China Scholarship Council [Grant No. 201606130059].

ORCID iDs

Muxi Lei  <https://orcid.org/0000-0003-2061-0685>

Twan van Hooff  <https://orcid.org/0000-0002-7811-2745>

Bert Blocken  <https://orcid.org/0000-0003-2935-9562>

References

1. IEA (International Energy Agency) & UNEP (United Nations Environment Programme). *2018 Global status report: towards a zero-emission, efficient and resilient buildings and construction sector*. Paris, France: Global Alliance for Buildings and Construction, <https://www.worldgbc.org/sites/default/files/2018GlobalABCGlobalStatusReport.pdf> (2018, accessed 16 November 2020).
2. IEA (International Energy Agency). *Tracking clean energy progress 2017. Energy technology perspectives 2017 excerpt. Informing energy sector transformations*. Paris, France: International Energy Agency, <https://www.iea.org/reports/tracking-clean-energy-progress-2017> (2017, accessed 16 November 2020).
3. IPCC (Intergovernmental Panel on Climate Change). *Climate change 2014: synthesis report. Contribution of working groups I, II and III to the fifth assessment report of the intergovernmental panel on climate change*. Geneva, Switzerland: IPCC, https://www.ipcc.ch/site/assets/uploads/2018/05/SYR_AR5_FINAL_full_wcover.pdf (2014, accessed 16 November 2020).
4. van Hooff T, Blocken B, Hensen JLM and Timmermans HJP. On the predicted effectiveness of climate adaptation measures for residential buildings. *Build Environ* 2014; 82: 300–316.
5. van Hooff T, Blocken B, Timmermans HJP and Hensen JLM. Analysis of the predicted effect of passive climate adaptation

- measures on energy demand for cooling and heating in a residential building. *Energy* 2016; 94: 811–820.
6. Cruz AS and da Cunha EG. The impact of climate change on the thermal-energy performance of the SCIP and ICF wall systems for social housing in Brazil. *Indoor Built Environ*. Epub ahead of print 9 August 2021. DOI: [10.1177/1420326X211038047](https://doi.org/10.1177/1420326X211038047).
 7. Kishore N. Impact of climate change on future bioclimatic potential and residential building thermal and energy performance in India. *Indoor Built Environ* 2022; 31: 329–354. DOI: [10.1177/1420326X21993919](https://doi.org/10.1177/1420326X21993919).
 8. CABEE (China Association of Building Energy Efficiency). China building energy consumption research report (2018). (in Chinese), <http://www.cabee.org/site/content/22960.html> (2018, accessed 6 April 2020).
 9. Climate Change Center of CMA (China Meteorological Administration). China blue book on climate change (2019). Beijing, China: Climate change center of China meteorological administration. (in Chinese), http://zwgk.cma.gov.cn/zfxxgk/gknr/qxbg/201905/t20190524_1709279.html (2019, accessed 6 September 2020).
 10. CNARCC (China's National Assessment Report on Climate Change) Editorial Committee. *China's national assessment report on climate change*. Beijing, China: Science Press, 2007. (in Chinese).
 11. Xiong J, Lian Z, Zhang H and Yoshino H. Correlation between health discomforts and temperature steps in winter of China. *Build Environ* 2017; 114: 387–396.
 12. Lin Z and Deng S. A questionnaire survey on sleeping thermal environment and bedroom air conditioning in high-rise residences in Hong Kong. *Energy Build* 2006; 38: 1302–1307.
 13. Canha N, Lage J, Candeias S, Alves C and Almeida SM. Indoor air quality during sleep under different ventilation patterns. *Atmos Pollut Res* 2017; 8: 1132–1142.
 14. Albers RAW, Bosch PR, Blocken B, van den Dobbelaer AAJF, van Hove LWA, Spit TJM, van de Ven F, van Hooff T and Rovers V. Overview of challenges and achievements in the climate adaptation of cities and in the climate proof cities program. *Build Environ* 2015; 83: 1–10.
 15. Ouyang J, Wang C, Li H and Hokao K. A methodology for energy-efficient renovation of existing residential buildings in China and case study. *Energy Build* 2011; 43: 2203–2210.
 16. Fan J-L, Yu H and Wei Y-M. Residential energy-related carbon emissions in urban and rural China during 1996–2012: from the perspective of five end-use activities. *Energy Build* 2015; 96: 201–209.
 17. Lin B and Liu H. A study on the energy rebound effect of China's residential building energy efficiency. *Energy Build* 2015; 86: 608–618.
 18. Zhao M, Künzel HM and Antretter F. Parameters influencing the energy performance of residential buildings in different Chinese climate zones. *Energy Build* 2015; 96: 64–75.
 19. Peng Z, Deng W and Hong Y. Materials consumption, indoor thermal comfort and associated energy flows of urban residential buildings: case studies from the cold climate zone of China. *Int J Build Pathol Adapt* 2019; 37: 579–596.
 20. Stovall TK, Biswas K, Song B and Zhang S. *Joint China-United States report for year 1 insulation materials and systems project area clean energy research center building energy efficiency (CERC-BEE) - Review of standards and codes pertinent to building practices and wall insulation systems*. Report number: ORNL/TM-2012/304. Oak Ridge, TN: Building Technologies Research and Integration Center (BTRIC), Energy and Transportation Science Division, Oak Ridge National Lab. (ORNL), <https://info.ornl.gov/sites/publications/files/Pub37945.pdf> (2012, accessed 24 May 2019).
 21. He Y and Xie X. *Living in China: a survey of changes in China's family dwellings since 1949*. Nanjing, China: Southeast University Press, 2017. (in Chinese).
 22. Wang F and Ge Q. Estimation of urbanization bias in observed surface temperature change in China from 1980 to 2009 using satellite land-use data. *Chin Sci Bull* 2012; 57: 1708–1715.
 23. Luo X, Yu CW, Zhou D and Gu Z. Challenges and adaptation to urban climate change in China: a viewpoint of urban climate and urban planning. *Indoor Built Environ* 2019; 28: 1157–1161.
 24. Barbosa R, Vicente R and Santos R. Climate change and thermal comfort in Southern Europe housing: a case study from Lisbon. *Build Environ* 2015; 92: 440–451.
 25. Ayikoe Tettey UY and Gustavsson L. Energy savings and overheating risk of deep energy renovation of a multi-storey residential building in a cold climate under climate change. *Energy* 2020; 202: 117578.
 26. Muñoz González CM, León Rodríguez AL, Suárez Medina R and Ruiz Jaramillo J. Effects of future climate change on the preservation of artworks, thermal comfort and energy consumption in historic buildings. *Appl Energy* 2020; 276: 115483.
 27. Jafarpur P and Berardi U. Effects of climate changes on building energy demand and thermal comfort in Canadian office buildings adopting different temperature setpoints. *J Build Eng* 2021; 42: 102725.
 28. Chai J, Huang P and Sun Y. Investigations of climate change impacts on net-zero energy building lifecycle performance in typical Chinese climate regions. *Energy* 2019; 185: 176–189.
 29. Liu S, Kwok YT, Lau KK-L, Ouyang W and Ng E. Effectiveness of passive design strategies in responding to future climate change for residential buildings in hot and humid Hong Kong. *Energy Build* 2020; 228: 110469.
 30. Liu S, Kwok YT, Lau KK-L, Tong HW, Chan PW and NG E. Development and application of future design weather data for evaluating the building thermal-energy performance in subtropical Hong Kong. *Energy Build* 2020; 209: 109696.
 31. Kristiansen AB, Zhao BY, Ma T and Wang RZ. The viability of solar photovoltaic powered off-grid zero energy buildings based on a container home. *J Clean Prod* 2021; 286: 125312.
 32. Zou Y, Lou S, Xia D, Lun IYF and Yin J. Multi-objective building design optimization considering the effects of long-term climate change. *J Build Eng* 2021; 44: 102904.

33. GB 50176-2016. *Code for thermal design of civil building*. MOHURD (ministry of housing and urban-rural development of the People's republic of China) & AQSIQ (general administration of quality supervision inspection and quarantine of the people's republic of China). Beijing, China: The Standardization Administration of China, 2016 (in Chinese).
34. U.S. Department of Energy. EnergyPlus, <https://energyplus.net/> (2019, accessed 16 February 2019).
35. Crawley DB, Lawrie LK, Winkelmann FC, Buhl WF, Huang YJ, Pedersen CO, Strand RK, Liesen RJ, Fisher DE, Witte MJ and Glazer J. EnergyPlus: creating a new-generation building energy simulation program. *Energy Build* 2001; 33: 319–331.
36. Olsen EL and Chen Q. Energy consumption and comfort analysis for different low-energy cooling systems in a mild climate. *Energy Build* 2003; 35: 560–571.
37. Gu L. *Overview of EnergyPlus development: new capabilities and applications for integrated building system design*, http://champs.syr.edu/workshop_2009/pdf/champs_workshop_2009_lixing_gu.pdf (2009, accessed 19 July 2021).
38. Zhai Z, Johnson M-H and Krarti M. Assessment of natural and hybrid ventilation models in whole-building energy simulations. *Energy Build* 2011; 43: 2251–2261.
39. Henninger RH and Witte MJ. *EnergyPlus testing with building thermal envelope and fabric load tests from ANSI/ASHRAE standard 140-2011. EnergyPlus version 8.0.0.008*. Washington, DC: U.S. Department of Energy, Energy Efficiency and Renewable Energy, Office of Building Technologies, 2013.
40. Carlucci S, Bai L, de Dear R and Yang L. Review of adaptive thermal comfort models in built environmental regulatory documents. *Build Environ* 2018; 137: 73–89.
41. GB/T 50785-2012. *Evaluation standard for indoor thermal environment in civil buildings*. MOHURD (Ministry of Housing and Urban-Rural Development of the People's Republic of China) & AQSIQ (General Administration of Quality Supervision, Inspection and Quarantine of the People's Republic of China). Beijing, China: The Standardization Administration of China, 2012 (in Chinese).
42. ASHRAE (American Society of Heating, Refrigerating and Air-Conditioning Engineers). International weather for energy calculations (IWECC weather files) users manual and CD-ROM, https://energyplus.net/weather-location/asia_wmo_region_2/CHN/CHN_Beijing.Beijing.545110_IWECC (2001, accessed 4 October 2019).
43. ASHRAE (American Society of Heating, Refrigerating and Air-Conditioning Engineers). International weather for energy calculations (IWECC weather files) users manual and CD-ROM, https://energyplus.net/weather-location/asia_wmo_region_2/CHN/CHN_Shanghai.Shanghai.583670_IWECC (2001, accessed 4 October 2019).
44. Jentsch MF, James PAB, Bourikas L and Bahaj AS. Transforming existing weather data for worldwide locations to enable energy and building performance simulation under future climates. *Renew Energy* 2013; 55: 514–524.
45. Sustainable Energy Research Group. *Manual for climate change world weather file generator - CCWorldWeatherGen, Version 1.9*. Southampton, UK: University of Southampton, <https://energy.soton.ac.uk/climate-change-world-weather-file-generator-for-world-wide-weather-data-ccworldweathergen/> (2017, accessed 11 September 2019).
46. Qian Y, Wang W, Leung LR and Kaiser DP. Variability of solar radiation under cloud-free skies in China: the role of aerosols. *Geophys Res Lett* 2007; 34: L12804.
47. Lawrimore JH, Ray R, Applequist S, Korzeniewski B and Menne MJ. *Global summary of the year (GSOY), version 1*. (Beijing, China. GHCND: CHM00054511. 1961-1990). NOAA National Centers for Environmental Information, DOI: [10.7289/JWPF-Y430](https://doi.org/10.7289/JWPF-Y430) (2016, accessed 26 October 2019).
48. Lawrimore JH, Ray R, Applequist S, Korzeniewski B and Menne MJ. *Global summary of the year (GSOY), version 1*. (Shanghai Hongqiao, Shanghai, China. GHCND: CHM00058367. 1961-1990). NOAA National Centers for Environmental Information, DOI: [10.7289/JWPF-Y430](https://doi.org/10.7289/JWPF-Y430) (2016, accessed 26 October 2019).
49. BMBS (Beijing Municipal Bureau of Statistics) & SONBSB (Survey Office of the National Bureau of Statistics in Beijing). *Beijing Statistical Yearbook 2018*. Beijing, China: China Statistics Press and Beijing Info Press, <http://tj.beijing.gov.cn/nj/main/2018-tjnj/zk/indexch.htm> (2018, accessed 27 October 2019).
50. Yang S, Wang MYL and Wang C. Socio-spatial restructuring in Shanghai: sorting out where you live by affordability and social status. *Cities* 2015; 47: 23–34.
51. Wang Y, Feng S, Deng Z and Cheng S. Transit premium and rent segmentation: a spatial quantile hedonic analysis of Shanghai Metro. *Transp Policy* 2016; 51: 61–69.
52. The Architectural Society of China. *The announcement of the second batch of Chinese architectural heritage of the 20th century*. (in Chinese), <http://www.chinaasc.org/news/117249.html> (2017, accessed 27 October 2019).
53. Liu Beijing Baiwanzhuang H.: the development of Jiefang style residence in China. *Beijing Plan Rev* 2018: 84–87. (in Chinese).
54. Chen K. Baiwanzhuang neighborhood, the sample of residence of People's republic of China. *Chin Herit* 2016: 120–133. (in Chinese).
55. Zuo Y. A study on the changes of apartment-living culture and historical features in modern Shanghai. *Time + Archit* 2016: 138–143. (in Chinese).
56. Lou C and Xue S. *Old Shanghai classic buildings*. Shanghai, China: Tongji University Press, 2002. (in Chinese).
57. Xue S and Lou C. *Old Shanghai classic apartments*. Shanghai, China: Tongji University Press, 2005. (in Chinese).
58. Office of Shanghai Chronicles. *Shanghai Mingjianzhu Zhi*. Shanghai, China: Shanghai Academy of Social Sciences Press, 2005. (in Chinese).
59. Xu J and Yan W. Historical development, preservation and renovation of Shanghai Lilong dwellings. *Hous Sci* 1983: 8–11. (in Chinese).

60. Liu L, Rohdin P and Moshfegh B. LCC assessments and environmental impacts on the energy renovation of a multi-family building from the 1890s. *Energy Build* 2016; 133: 823–833.
61. *Pre-owned housing of Yin region, Baiwanzhuang*. (in Chinese). <https://bj.lianjia.com/ershoufang/101104654493.html> (2019, accessed 27 October 2019).
62. *Pre-owned housing of Yongjia New Village*. (in Chinese). <https://sh.lianjia.com/ershoufang/107010076903.html> (2016, accessed 27 October 2019).
63. Li Y, Wang Y and Zou Y. The study on acoustic environment planning of old residential neighbourhood renovation - taking Baiwanzhuang neighbourhood as an example. *Urban Probl* 2008: 43–47. (in Chinese).
64. Song D and Chen Y. The renovation of Shanghai Alleys from dual angles of historic preservation and ecological energy saving. *Hous Sci* 2010; 30: 55–59. (in Chinese).
65. CIBSE (The Chartered Institution of Building Services Engineers). *Environmental design - CIBSE guide A*. 8th ed.. London, UK: CIBSE, 2015.
66. ASHRAE (American Society of Heating, Refrigerating and Air-Conditioning Engineers). *2021 ASHRAE handbook - Fundamentals (SI Edition)*. Peachtree Corners, GA: American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc., 2021.
67. *EN ISO 6946: 2007 - Building components and building elements - Thermal resistance and thermal transmittance - Calculation method*. Brussels, Belgium: European Committee for Standardization, 2007.
68. Bretz S, Akbari H, Rosenfeld A and Taha H. *Implementation of solar-reflective surfaces: materials and utility programs*. Report number: LBL-32467. Berkeley, CA: Energy Analysis Program, Energy & Environment Division, Lawrence Berkeley Laboratory, University of California, 1992. DOI: [10.2172/10172670](https://doi.org/10.2172/10172670).
69. Hu S, Yan D, An J, Guo S and Qian M. Investigation and analysis of Chinese residential building occupancy with large-scale questionnaire surveys. *Energy Build* 2019; 193: 289–304.
70. GB/T 18048-2008/ISO 8996: 2004. *Ergonomics of the thermal environment - Determination of metabolic rate*. AQSIQ (General Administration of Quality Supervision, Inspection and Quarantine of the People's Republic of China) & SAC (Standardization Administration of the People's Republic of China). Beijing, China: The Standardization Administration of China, 2008 (in Chinese).
71. Lam JC, Tsang CL, Li DHW and Cheung SO. Residential building envelope heat gain and cooling energy requirements. *Energy* 2005; 30: 933–951.
72. Rea MS (ed). *Lighting handbook: reference & application*. 8th ed.. New York, NY: Illuminating Engineering Society of North America, 1993.
73. JGJ 26-2018. Design standard for energy efficiency of residential buildings in severe cold and cold zones. MOHURD (Ministry of Housing and Urban-Rural Development of the People's Republic of China). Beijing, China: China Architecture & Building Press, 2018 (in Chinese).
74. Hasan A, Kurnitski J and Jokiranta K. A combined low temperature water heating system consisting of radiators and floor heating. *Energy Build* 2009; 41: 470–479.
75. Deng J, Tian Z, Fan J, Yang M, Furbo S and Wang Z. Simulation and optimization study on a solar space heating system combined with a low temperature ASHP for single family rural residential houses in Beijing. *Energy Build* 2016; 126: 2–13.
76. DGJ 08-205-2015. J 10044-2015. *Design standard for energy efficiency of residential buildings*. SHURCMC (Shanghai Housing and Urban-Rural Construction and Management Committee). Shanghai, China: Tongji University Press, 2015 (in Chinese).
77. JGJ 134-2010. *Design standard for energy efficiency of residential buildings in hot summer and cold winter zone*. MOHURD (Ministry of Housing and Urban-Rural Development of the People's Republic of China). Beijing, China: China Architecture & Building Press, 2010 (in Chinese).
78. Li X, Yao R, Yu W, Meng X, Liu M, Short A and Li B. Low carbon heating and cooling of residential buildings in cities in the hot summer and cold winter zone - A bottom-up engineering stock modeling approach. *J Clean Prod* 2019; 220: 271–288.
79. Lawrence Berkeley Laboratory. *DOE2.1E-053 source code*. Berkeley, CA: Lawrence Berkeley Laboratory, 1994.
80. Mirsadeghi M, Cóstola D, Blocken B and Hensen JLM. Review of external convective heat transfer coefficient models in building energy simulation programs: implementation and uncertainty. *Appl Therm Eng* 2013; 56: 134–151.
81. Walton GN. *Thermal analysis research program reference manual*. NBSIR 83-2655. Washington, DC: U.S. Department of Commerce, National Bureau of Standards, National Engineering Laboratory, Building Physics Division, 1983.
82. DB11/891-2012. Design standard for energy efficiency of residential buildings. BMCUP (Beijing Municipal Commission of Urban Planning) & BMAQTS (Beijing Municipal Administration of Quality and Technology Supervision). Beijing, China: Standardization Office of Urban-Rural Planning of Beijing, 2012 (in Chinese).
83. CECS 284: 2010. *Technical specification for kitchen and bathroom of medium-small apartments*. CECS (China Association for Engineering Construction Standardization). Beijing, China: China Planning Press, 2010 (in Chinese).
84. Chen S, Levine MD, Li H, Yowargana P and Xie L. Measured air tightness performance of residential buildings in North China and its influence on district space heating energy use. *Energy Build* 2012; 51: 157–164.
85. Shi S, Chen C and Zhao B. Air infiltration rate distributions of residences in Beijing. *Build Environ* 2015; 92: 528–537.

86. Vasaturo R, van Hooff T, Kalkman I, Blocken B and van Wesemael P. Impact of passive climate adaptation measures and building orientation on the energy demand of a detached lightweight semi-portable building. *Build Simul* 2018; 11: 1163–1177.
87. Zou J and Du X. Reasonable comfort and low-energy consumption for housing in Beijing. *World Archit* 2006: 28–31. (in Chinese)
88. Gen K and Du X. Investigation and analysis on Tianjin multi-storey housing energy consumption and indoor thermal environment. *Hous Sci* 2008: 12–17. (in Chinese).
89. Fosas D, Coley DA, Natarajan S, Herrera M, Fosas de Pando M and Ramallo-Gonzalez A. Mitigation versus adaptation: does insulating dwellings increase overheating risk? *Build Environ* 2018; 143: 740–759.